


TEST REPORT

(No part of the report can be duplicated without permission)

Report No. : NPS019121421UK
Sample Trademark :
Name of Sample : Insulated Flexible Duct
Sample Model : Insulated Flexible Duct
Test Category : Fire tests
Test Requested : BS 476 Part 6, Part 20
Test Method : BS476 Fire tests on building materials and structures
Part 6: Method of test for fire propagation for products.
Part 20: Method for Determination of the Fire Resistance of
Elements of Construction (General Principles)
Testing Period : December 24, 2019 - January 16, 2020
Date of Issue : January 16, 2020
Test Results : Pass

NPS

Signed for and on behalf of Consumer
NPS Laboratory Company Limited



Technical director

NPS Laboratory

H K Phone:+86-769-8701 5678

U K Phone:+44-20-37342132

USA Phone:+1-213-2895039

www.nps.hk

www.nps.gs

www.nps.cn

[e nps@nps.hk](mailto:nps@nps.hk)

[e nps@nps.gs](mailto:nps@nps.gs)

[e nps@nps.cn](mailto:nps@nps.cn)



This report is for the exclusive use of NPS's Client and is provided pursuant to the agreement between NPS and its Client. NPS's responsibility and liability are limited to the terms and conditions of the agreement. NPS assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this report. Only the Client is authorized to permit copying or distribution of this report and then only in its entirety. Any use of the NPS name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by NPS. The observations and test results in this report are relevant only to the sample tested. This report by itself does not imply that the material, product, or service is or has ever been under an NPS certification program.

TEST REPORT

ITEMS FOR ATTENTION

1. This report is submitted for the exclusive use of the client to whom it is addressed.
2. It would be invalid test report without specific stamp for test institute or the authority.
3. It would be invalid duplicated report without specific stamp for test institute or the authority.
4. It would be invalid test report without all the signatures of reporter, reviewer.
5. It would be invalid test report, if there is any scrawl in the test report without official authorization.
6. Any disputes about the report must be submitted for test institute within 15 days from the day when the report is received, otherwise that would be invalid out of expiry.
7. Generally, the responsible is only for the samples in entrusted test.

TEST REPORT

Product Detail	Sample Name	Insulated Flexible Duct
	Sample Model	Insulated Flexible Duct
	Appearance&Color	Odorless
Test Content	Test Item	BS476 Part6 Part20 Test
	Test Requested	BS476 Fire tests on building materials and structures-Part 6: Method of test for fire propagation for products. Part 20: Method for Determination of the Fire Resistance of Elements of Construction (General Principles)
	Test Result	PASS
	Conclusion	The submitted samples complied with the requirement of above safety Standards.
Testing Laboratory	Applicant	NPS CHINA TEST LABORATORY
	Address	NPS building, No.160,GuanChang Road,ChangAnTown DongGuan City,GuangDong Province,China 523855
Remark	<ol style="list-style-type: none"> 1) When determining for test conclusion, measurement uncertainty of tests has been considered. 2) This report shall not be reproduced except in full without the written approval of the testing laboratory. 	
<div style="display: flex; justify-content: space-between;"> <div style="width: 45%;"> <p>Tested by:  Engineer: Jack chen January 15, 2020</p> </div> <div style="width: 45%;"> <p>Reviewed by:  Supervisor: Andy Yang January 16, 2020</p> </div> </div>		

TEST REPORT

List of test items:

Number	Test Item	Result
1	BS476 Part 6:1989+A1:2009	Pass
2	BS476 Part 20:1987	Pass
/	/	/

Below is blank

Possible test case verdicts

- Test case does not apply to the test object.....: N/A
- Test object does meet the requirement: P (Pass)
- Test object does not meet the requirement: F (Fail)

TEST REPORT

BS 476 Part 6

Clause	Requirement - Test	Result - Remark	Verdict
–	<p>Fire propagation</p> <p>Prior to testing, the sample was conditioned, to constant mass at a temperature of 23 ± 2 °C, and a relative humidity of 50 ± 10 %, and maintained in this condition until required for testing. Three specimens with dimension of 225×225mm were tested according to clause 9 of BS 476-6, and the test result was calculated through clause 10 of BS 476-6.</p>	<p>Fire propagation index: 18.87;</p> <p>Refer to 'Appendix A – Test data' for detail.</p>	P
<p>Below is blank</p>			

TEST REPORT

Appendix A

Test Data

Throughout the test on each specimen, carefully observe the material's behaviour within the apparatus and take special note of any of the following phenomena listed in clause 9.2 of the standard. None of the listed phenomena was observed and the test results on all three specimens tested were valid.

The index of the performance for the specimen was determined as follows:

$$S_1 = \sum_{t=0.5}^{t=3} \frac{\theta_s - \theta_c}{10t}, S_2 = \sum_{t=4}^{t=10} \frac{\theta_s - \theta_c}{10t}, S_3 = \sum_{t=12}^{t=20} \frac{\theta_s - \theta_c}{10t}, S = S_1 + S_2 + S_3$$

Where:

- S = index of performance for each of the specimens tested and S1, S2 and S3 are sub-indices;
- t = Time in minutes from the origin which reading are taken;
- θ_s = Temperature rise in °C for the specimen at time, t;
- θ_c = Temperature rise in °C for the calibration sheet at time, t.

$$\text{Fire Propagation index } I = i_1 + i_2 + i_3$$

Where, i_1 , i_2 and i_3 are given by the expressions:

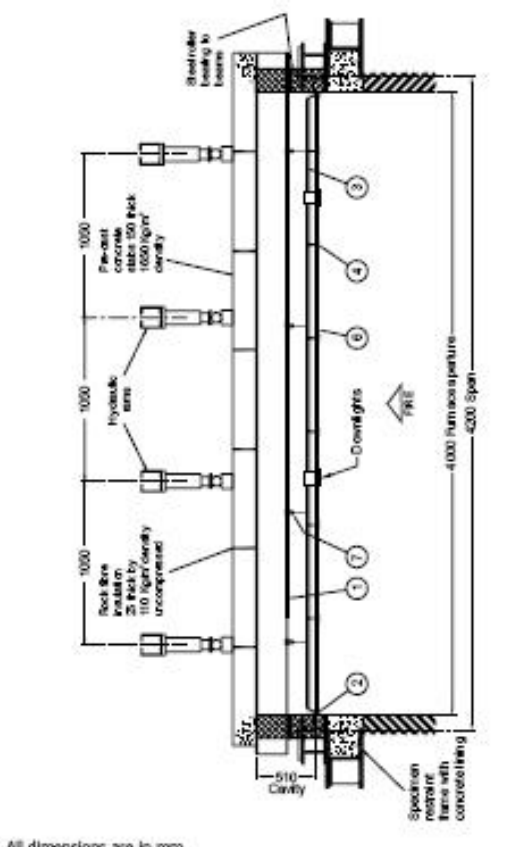
$$i_1 = \frac{1}{3} [(S_1)_A + (S_1)_B + (S_1)_C], i_2 = \frac{1}{3} [(S_2)_A + (S_2)_B + (S_2)_C], i_3 = \frac{1}{3} [(S_3)_A + (S_3)_B + (S_3)_C]$$

The following test results were obtained for each specimen tested:

Specimen No.	Sub-indices			Index of performance
	S1	S2	S3	S
A	5.35	8.09	5.65	19.09
B	5.08	7.99	5.63	18.69
C	5.25	7.99	5.61	18.85
Number of specimens tested	Sub-index	Sub-index	Sub-index	Fire propagation
	i_1	i_2	i_3	I
3	5.22	8.02	8.63	18.87

Note: If a suffix "R" is included in the above fire propagation index I, this indicates that the results should be treated with caution.

TEST REPORT

BS 476 Part 20			
Clause	Requirement - Test	Result - Remark	Verdict
-	<p>A total load of 8134 kg was applied to the beam by four point loads produced by hydraulic rams. The rams were positioned at distance 1/8, 3/8, 5/8 and 7/8 of the span of the beam, as shown in Figure 1. The applied load, together with the dead load, was calculated to develop the maximum permissible stress in bending. The load was kept constant for 108 minutes, after which time it was removed from the beam.</p>	Loading Conditions	P
-		Figure 1 – Longitudinal Section	P

TEST REPORT

Photograph



Photo 1#

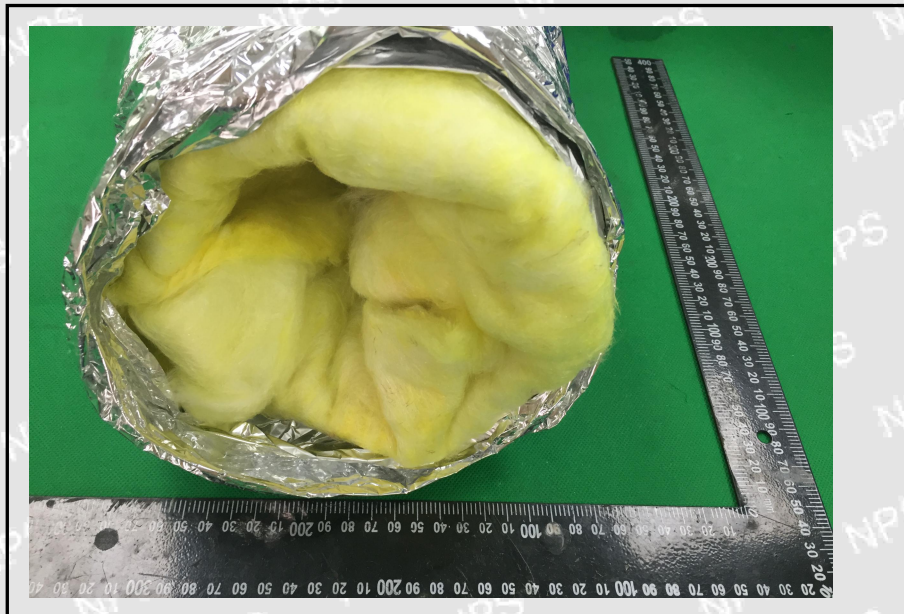


Photo 2#

NPS authenticate the photo on original report only.

***End of Report ***